



ABOVE GROUND POOLS

111 S. Nelson Ave, Wilmington, OH 45177

937.382.3335

buildingandzoning@clintoncountyohio.us


INSPECTION:

1. ELECTRIC TRENCH & BONDING BEFORE BACKFILLING
2. FINAL ELECTRIC INSPECTION
3. CALL 937.382.3335 BEFORE BACKFILLING

IF YOU PLAN ANY LIGHTING WITHIN 16' OF THE POOL YOU WILL NEED TO TALK TO THE PLANS EXAMINER. 513-695-1290

NO OUTLETS WITHIN 6' OF THE POOL

CONTACT YOUR ZONING DEPARTMENT FOR FENCE REQUIREMENTS

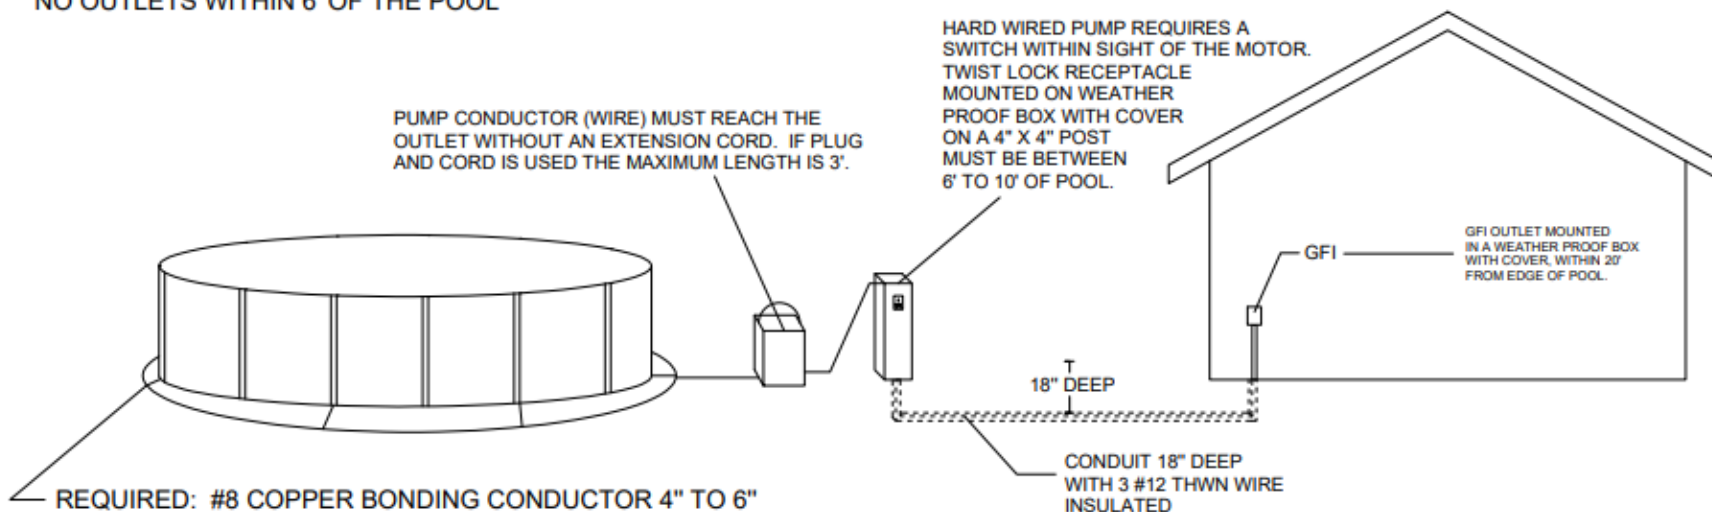

REQUIRED: #8 COPPER BONDING CONDUCTOR 4" TO 6" DEEP 18" TO 24" FROM THE POOL EDGE TO CIRCLE THE ENTIRE POOL AND CONNECTED TO THE MOTOR GROUND.

MUST BOND ALL METAL POOL PARTS TO THE COPPER BONDING RING

THIS IS ONLY A PARTIAL LIST OF CODE REQUIREMENTS, REFERENCE THE OHIO BUILDING CODE AND NATIONAL ELECTRIC CODE FOR DETAILS.

ABOVE GROUND POOLS

NO OUTLETS WITHIN 6' OF THE POOL

ABOVE-GROUND POOL

PUMP CONDUCTOR (WIRE) MUST REACH THE OUTLET WITHOUT AN EXTENSION CORD. IF PLUG IN WIRE IS USED THE MAX LENGTH IS 3'

PUMP

HARD WIRED PUMP REQUIRES A SWITCH WITHIN SIGHT OF THE MOTOR. TWIST LOCK RECEPTACLE MOUNTED ON WEATHER PROOF BOX WITH COVER ON A 4" x 4" POST

1/2" CONDUIT 18" DEEP WITH 3 #12 THWN WIRE INSULATED

GFI OUTLET MOUNTED IN A WEATHER PROOF BOX WITH COVER (IF LESS THAN 20' FROM POOL)

REQUIRED: #8 COPPER BONDING CONDUCTOR 4" TO 6" DEEP 18" TO 24" FROM THE POOL EDGE TO CIRCLE THE ENTIRE POOL AND CONNECTED TO THE MOTOR GROUND AND THE METAL PARTS OF THE POOL.

INSPECTIONS:

1. ELECTRIC TRENCH & BONDING BEFORE BACKFILLING
2. FINAL ELECTRIC INSPECTION
3. CALL 937.382.3335 TO SCHEDULE INSPECTION, ALLOW 24 TO 72 HOURS

IF YOU PLAN ANY LIGHTING IN OR WITHIN 16' OF THE POOL YOU WILL NEED TO TALK TO THE PLANS EXAMINER @ 513-695-1290

HOUSE